



## Joint Base Pearl Harbor-Hickam (JBPHH) Public Water System No. HI0000360

### Drinking Water Distribution System Recovery Plan: *Stage 5 Long-Term Monitoring (LTM) Period 6 Sampling Results Report for Zone F1* 13 December 2023



*Neighborhoods included in Zone F1: NEX, Moanalua Terrace*




## EXECUTIVE SUMMARY FOR ZONE F1

**This report documents the results of Long-Term Monitoring (LTM) testing for Zone F1. We are sharing this information with you to keep you updated on your water quality.**

**This LTM testing was performed after the November 29, 2021 Public Health Advisory for the JBPHH Public Water System<sup>1</sup> for Zone F1 was amended by the Hawaii Department of Health (DOH) on March 11, 2022. The amended health advisory for Zone F1 can be found online at: <https://jbphh-safewaters.org>. The amended health advisory states that tap water can be used for all purposes including drinking, cooking, oral hygiene, and consumption by pets. The health advisory was amended based on a final review of all sample data and how the Navy water system maintains operations to ensure safe drinking water. Test results that led to the advisory amendment are summarized in the Stage 4 Residential Sampling Report. After the health advisory was amended, residents were informed that they can safely use their water for all purposes.**

Zone F1 has been thoroughly flushed, sampled, and tested. This zone has completed each stage (i.e., Stage 1 - Distribution System Flushing through Stage 4 - Building Sampling), as outlined in the Drinking Water Distribution System Recovery Plan.<sup>2</sup> Based on the samples collected and tested from water mains (Stage 2) and residences, buildings, schools, and child development centers (Stage 4), this zone meets the U.S. Environmental Protection Agency (EPA) and DOH drinking water standards used during this investigation. Zone F1 is now in the LTM phase (a.k.a., Stage 5), which is described below. For additional information on the Stage 2, Stage 4, and Stage 5 sample results by zone, please visit: <https://jbphh-safewaters.org>.

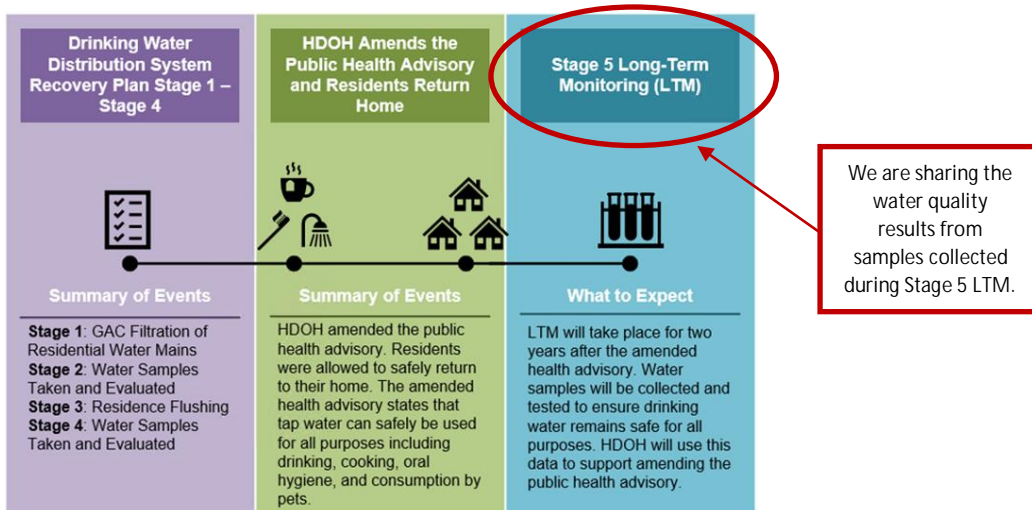

<sup>1</sup> Public Health Advisory for the JBPHH Public Water System: <https://health.hawaii.gov/news/files/2021/11/21-165-DOH-advises-Navy-water-system-consumers-not-to-drink-consume-tap-water.pdf>

<sup>2</sup> The Drinking Water Distribution System Recovery Plan was developed and approved by the Interagency Drinking Water System Team (IDWST). The DOH, EPA, Navy, and Army formed the IDWST to restore safe drinking water to all Navy Water System users. The JBPHH PWS #HI0000360 will continue the work of the IDWST by working to restore consumer confidence by ensuring tap water continues to be safe for human consumption (e.g., drinking, cooking, and oral hygiene).



## Long-Term Monitoring

LTM will be performed as outlined in the Final Drinking Water Sampling and Long-Term Monitoring Plan, dated June 2022. LTM will take place for two years after the date of the amended health advisory. The purpose of LTM is to ensure tap water continues to be safe for human consumption (e.g., drinking, cooking, and oral hygiene). All required samples under the LTM have met the requirements for this Period (Period 6). The results of any additionally requested samples after the completion date (see table below) will be included under the Sampling Results for Zone F1 on the Safe Waters website: <https://jbphh-safewaters.org>. Residents/occupants will be notified if and when their house/building is scheduled to be sampled. Below is the schedule for LTM in Zone F1.

### LTM Schedule for Zone F1

Sampling Event <sup>1</sup>	Summary of Sampling Activities	Completion Date <sup>2</sup>
Period 1	5% of houses/buildings (minimum of 5 houses/buildings)	March 22 - April 28, 2022
Period 2	5% of houses/buildings (minimum of 5 houses/buildings)	April 15 - April 29, 2022
Period 3	5% of houses/buildings (minimum of 5 houses/buildings)	May 25 - June 21, 2022
Period 4	10% of houses/buildings	June 28 – October 24, 2022
Period 5	10% of houses/buildings	January 17 – May 1, 2023
Period 6	10% of houses/buildings	June 30 – October 27, 2023
Period 7	10% of houses/buildings	March 2024

Notes:

<sup>1</sup> Sampling events are scheduled based on the amount of time (months) since the DOH health advisory was amended for this zone.

<sup>2</sup> Completion dates are estimated based on the date the DOH health advisory was amended for this zone.



**Tables Included in this Stage 5 Sampling Results Report for Zone F1**

<b>Table</b>	<b>Description</b>	<b>Page</b>
Table 1-1.	Contaminants Detected in Drinking Water Samples Collected from Residences in Zone F1 .....	1
Table 1-2.	Contaminants Detected in Drinking Water Samples Collected from Schools in Zone F1 .....	4
Table 1-3.	Contaminants Detected in Drinking Water Samples Collected from Child Development Centers in Zone F1 .....	6
Table 1-4.	Contaminants Detected in Drinking Water Samples Collected from Other Buildings in Zone F1 .....	8
Table 1-5.	Contaminants Detected in Drinking Water Samples Collected from Fire Hydrants in Zone F1 .....	11
Table 1-6.	Contaminants Detected in Drinking Water Samples Collected from JBPHH’s Source Water (Waiawa Shaft - Post Chlorination) .....	13





**Table 1-1. Contaminants Detected in Drinking Water Samples Collected from Residences in Zone F1**

Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7	
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024	
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>
<b>Contaminants of Concern<sup>1</sup></b>																				
Benzene	Discharge from factories; Leaching from gas storage tanks and landfills	ppb <sup>6</sup>	5.0	MCL	0/95	-	0/43	-	0/42	-	0/43	-	0/86	-	0/84	-	0/88	-	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Ethylbenzene	Discharge from petroleum refineries	ppb	700	MCL	0/95	-	0/43	-	0/42	-	0/43	-	0/86	-	0/84	-	0/88	-		
Toluene	Discharge from petroleum factories	ppb	1,000	MCL	0/95	-	0/43	-	0/42	-	0/43	-	0/86	-	0/84	-	0/88	-		
Xylenes (Total)	Discharge from petroleum factories; Discharge from chemical factories	ppb	10,000	MCL	0/95	-	0/43	-	0/42	-	0/43	-	0/86	-	0/84	-	0/88	-		
1-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also, present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites.	ppb	10	EAL	0/95	-	0/43	-	0/42	-	0/43	-	0/86	-	0/84	-	0/88	-		
2-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also used to make vitamin K; and is present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites	ppb	10	EAL	0/95	-	0/43	-	0/42	-	0/43	-	0/86	-	0/84	-	0/88	-		
Naphthalene	Naphthalene is found in coal tar or crude oil and is used in the manufacture of plastics, resins, fuels, and dyes, and as a fumigant	ppb	17	EAL	0/95	-	0/43	-	0/42	-	0/43	-	0/86	-	0/84	-	0/88	-		
Total TPH <sup>4</sup>	TPH is petroleum and can contaminate drinking water through spills and other releases into the environment	ppb	266 <sup>9</sup>	ISP	0/95	-	7/43	ND - 96 (71)	5/42	ND - 60 (57)	14/43	ND - 119 (72)	25/86	ND - 159 (67)	55/84	ND - 98 (66)	58/88	ND - 256 (76)		
Total Organic Carbon (TOC) <sup>5</sup>	Naturally present in the environment, but also can be an indicator of contamination, including petroleum or other sources	ppb	4,000	ISP	24/95	ND - 3,360 (1,943)	15/43	ND - 670 (455)	0/42	-	0/43	-	1/86	ND - 310 (310)	1/84	ND - 730 (730)	0/88	-		
Free Chlorine (Field Test) <sup>8</sup>	Water additive used to control microbes	ppb	4,000	ISP	-	-	37/38	ND - 1,370 (431)	38/38	30 - 650 (316)	38/38	20 - 940 (308)	77/77	110 - 1050 (354)	77/77	30 - 680 (305)	83/83	20 - 970 (449)		
<b>Metals</b>																				
Antimony	Discharge from petroleum refineries; fire retardants; ceramics; electronics; solder	ppb	6.0	MCL	0/94	-	1/43	ND - 0.10 (0.10)	1/42	ND - 0.12 (0.12)	3/43	ND - 0.16 (0.15)	5/86	ND - 0.22 (0.17)	6/84	ND - 0.14 (0.12)	0/92	-	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Arsenic	Erosion of natural deposits; Runoff from orchards; Runoff from glass and electronics production wastes	ppb	10	MCL	10/94	ND - 0.58 (0.28)	1/43	ND - 0.56 (0.56)	0/42	-	5/43	ND - 0.62 (0.53)	2/86	ND - 0.58 (0.56)	0/84	-	22/92	ND - 1.0 (0.65)		
Barium	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits	ppb	2,000	MCL	94/94	1.8 - 7.2 (2.2)	43/43	1.8 - 2.4 (1.9)	42/42	1.9 - 2.2 (2.0)	43/43	1.9 - 2.2 (2.0)	86/86	1.8 - 2.8 (2.0)	84/84	1.2 - 2.4 (1.9)	92/92	1.8 - 2.5 (1.9)		



Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7	
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024	
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>
Beryllium	Discharge from metal refineries and coal-burning factories; Discharge from electrical, aerospace, and defense industries	ppb	4.0	MCL	0/94	-	1/43	ND - 0.50 (0.50)	0/42	-	0/43	-	0/86	-	0/84	-	1/92	ND - 0.24 (0.24)	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Cadmium	By-product of drinking water disinfection	ppb	5.0	MCL	0/94	-	1/43	ND - 0.15 (0.15)	1/42	ND - 0.32 (0.32)	0/43	-	0/86	-	0/84	-	0/92	-		
Chromium	Discharge from steel and pulp mills; Erosion of natural deposits	ppb	100	MCL	90/94	ND - 2.8 (1.5)	43/43	0.55 - 2.3 (1.4)	42/42	0.85 - 1.4 (1.0)	43/43	0.53 - 1.2 (1.0)	85/86	ND - 2 (1.4)	84/84	1.0 - 2.6 (1.7)	54/92	ND - 1.0 (0.75)		
Copper	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	1,300	MCL	94/94	16 - 520 (78)	43/43	18 - 110 (63)	42/42	16 - 147 (51)	43/43	14 - 151 (56)	86/86	8.7 - 121 (49)	84/84	18 - 168 (65)	92/92	9.7 - 126 (45)		
Lead	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	15	MCL	41/94	ND - 3.7 (0.40)	32/43	ND - 2.1 (0.50)	25/42	ND - 9.7 (0.90)	21/43	ND - 2.5 (0.40)	59/86	ND - 3.9 (0.51)	29/84	ND - 7.4 (0.86)	44/92	ND - 6.0 (0.63) <sup>10</sup>		
Mercury	Erosion of natural deposits; Discharge from refineries and factories; Runoff from landfills; Runoff from cropland	ppb	2.0	MCL	1/94	ND - 0.09 (0.09)	0/43	-	2/42	ND - 0.026 (0.026)	2/43	ND - 0.10 (0.089)	4/86	ND - 0.058 (0.045)	0/84	-	7/88	ND - 0.032 (0.029)		
Selenium	Discharge from petroleum and metal refineries; Erosion of natural deposits; Discharge from mines	ppb	50	MCL	18/94	ND - 1.6 (1.1)	0/43	-	36/42	ND - 1.0 (0.68)	29/43	ND - 2.2 (1.0)	59/86	ND - 1.5 (0.58)	2/84	ND - 0.42 (0.37)	92/92	0.79 - 2.7 (1.7)		
Thallium	Leaching from ore-processing sites; Discharge from electronics, glass, and drug factories	ppb	2.0	MCL	5/94	ND - 0.10 (0.086)	2/43	ND - 0.17 (0.11)	2/42	ND - 0.10 (0.089)	0/43	-	2/86	ND - 0.075 (0.068)	0/84	-	1/92	ND - 0.18 (0.18)		
<b>Volatile Organic Compounds (VOCs)</b>																				
Total Haloacetic acids (sum of mono-, di-, trichloroacetic acids and mono- and dibromo acetic acids)	By-product of drinking water disinfection	ppb	60	MCL	-	-	0/43	-	1/42	ND - 1.3 (1.3)	1/43	ND - 2.2 (2.2)	0/86	-	2/84	ND - 1.3 (1.0)	0/88	-	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Total trihalomethanes (sum of chloroform, bromoform, 2-bromodichloromethane, and di-bromochloromethane)	By-product of drinking water disinfection	ppb	80	MCL	-	-	36/43	ND - 1.9 (1.1)	6/42	ND - 6.0 (2.5)	34/43	ND - 11 (2.1)	58/86	ND - 6.8 (1.1)	74/84	ND - 3.9 (0.60)	57/88	ND - 2.0 (0.59)		
<b>Synthetic Organic Compounds (SOCs) or Semi-Volatile Organic Compounds (SVOCs)</b>																				
Benzo(a)pyrene	Leaching from linings of water storage tanks and distribution lines	ppb	0.20	MCL	0/95	-	1/43	ND - 0.024 (0.024)	1/42	ND - 0.033 (0.033)	0/43	-	0/86	-	4/84	ND - 0.016 (0.013)	4/88	ND - 0.11 (0.068)	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Bis(2-ethylhexyl)phthalate	Discharge from rubber and chemical factories	ppb	6.0	MCL	0/95	-	1/43	ND - 0.51 (0.51)	4/42	ND - 5.3 (2.9)	2/43	ND - 1.8 (1.2)	3/86	ND - 1 (0.63)	1/84	ND - 3.4 (3.4)	5/88	ND - 1.3 (0.68)		

Notes:  
 1. These contaminants are listed whether detected or non-detect (ND) because these are incident specific. All other contaminants are only listed if detected.



2. The DOH uses multiple criteria to assess the safety of the drinking water including maximum contaminant levels (MCLs), previously established environmental action levels (EALs), and incident specific parameters (ISPs).
3. These numbers are the minimum and maximum values from all the sample test results. The average (or mathematical mean) includes all sample test results with a detectable contaminant. An average is the sum of the results (excluding non-detects) divided by the total number results with detection only. Acronyms and explanation of terms used in this table are presented on the following pages.
4. For more information regarding Total Petroleum Hydrocarbons, refer to the FACT SHEET What Are Petroleum Hydrocarbons?, available online at: [https://health.hawaii.gov/about/files/2021/12/21.12.16\\_What-Are-Petroleum-Hydrocarbons.pdf](https://health.hawaii.gov/about/files/2021/12/21.12.16_What-Are-Petroleum-Hydrocarbons.pdf).
5. Total Organic Carbon (TOC) test results report any constituent containing carbon, many of which are naturally occurring and some of which may be man-made. The DOH had previously selected a TOC project screening level of 2,000 ppb under Stage 4. Each exceedance was investigated by reviewing the associated water quality data (e.g., BTEX results, TPH) and the IDWST determined that all TOC exceedances were inconclusive in association with petroleum hydrocarbons. Under the Drinking Water Long Term Monitoring Plan (under review during the LTM Period 3 report for Zone F1), DOH revised the TOC screening level to 4,000 ppb (previously 2,000 ppb).
6. Parts per billion (ppb) refers to the amount (or concentration) of a contaminant in the water.
7. Cells highlighted in **green** indicate the water sample results were below DOH Screening Levels.
8. On January 30 and February 25, 2022, DOH revised the LTM requirements to include the analysis of free chlorine. Chlorine is typically used as an additive to drinking water for disinfection purposes.
9. Per the June 2022 Drinking Water Long-Term Monitoring Plan, the ISP for Total TPHs was changed to 266 ppb (previously it was 211 ppb). The June 2022 Drinking Water Long-Term Monitoring Plan is available online at: <https://health.hawaii.gov/about/files/2022/08/JBPHH-Drinking-Water-LTM-Plan-FINAL-20220823.pdf>.
10. This does not include the August 28, 2023 (initial) lead sample from 4933 Kidd Court (Field Sample Number: F1-TW-0008807-23155-N). This does include the resampled results from the residence. This exceedance was associated with Premise Plumbing and is not associated with the JBPHH water distribution system. Therefore, it was not included in the table. See section "What was Found?" in the main text of this report for a complete discussion of this exceedance.
  - a) The sample result taken from 4933 Kidd Court on August 28, 2023 was 16.6 ppb for lead. This exceeded the action level of 15 ppb. The resident was advised not to consume water and was provided bottled water. All faucets at the residence were flushed and the Navy conducted resampling of the residence faucets on September 6, 2023. The resample results at the original location (Field Sample Number: F1-TW-0008807-23155-N-R1), as well as the additional samples (Field Sample Numbers: F1-TW-0008807-23155-N-1 through 3), did not exceed the action level.



**Table 1-2. Contaminants Detected in Drinking Water Samples Collected from Schools in Zone F1**

Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7	
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024	
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>
<b>Contaminants of Concern<sup>1</sup></b>																				
Benzene	Discharge from factories; Leaching from gas storage tanks and landfills	ppb <sup>6</sup>	5.0	MCL	0/16	-	0/5	-	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
Ethylbenzene	Discharge from petroleum refineries	ppb	700	MCL	0/16	-	0/5	-	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
Toluene	Discharge from petroleum factories	ppb	1,000	MCL	0/16	-	0/5	-	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
Xylenes (Total)	Discharge from petroleum factories; Discharge from chemical factories	ppb	10,000	MCL	0/16	-	0/5	-	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
1-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also, present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites.	ppb	10	EAL	0/16	-	0/5	-	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
2-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also used to make vitamin K; and is present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites	ppb	10	EAL	0/16	-	0/5	-	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
Naphthalene	Naphthalene is found in coal tar or crude oil and is used in the manufacture of plastics, resins, fuels, and dyes, and as a fumigant	ppb	17	EAL	0/16	-	0/5	-	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
Total TPH <sup>4</sup>	TPH is petroleum and can contaminate drinking water through spills and other releases into the environment	ppb	266 <sup>10</sup>	ISP	1/16	ND - 180 (180)	0/5	-	0/5	-	1/6	ND - 62 (62)	3/5	ND - 63 (60)	0/4	-	5/5	54 - 88 (65)		
Total Organic Carbon (TOC) <sup>5</sup>	Naturally present in the environment, but also can be an indicator of contamination, including petroleum or other sources	ppb	4,000	ISP	6/16	ND - 4,020 (2,200)	1/5	ND - 490 (490)	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
Free Chlorine (Field Test) <sup>8</sup>	Water additive used to control microbes	ppb	4,000	ISP	-	-	5/5	260 - 600 (394)	5/5	160 - 490 (376)	5/5	120 - 670 (314)	5/5	260 - 540 (436)	5/5	180 - 450 (334)	5/5	150 - 710 (426)		
<b>Metals</b>																				
Arsenic	Erosion of natural deposits; Runoff from orchards; Runoff from glass and electronics production wastes	ppb	10	MCL	2/16	ND - 0.16 (0.14)	0/5	-	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
Barium	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits	ppb	2,000	MCL	16/16	1.9 - 2.2 (2.1)	5/5	1.8 - 2.0 (1.9)	5/5	2.0 - 2.1 (2.0)	6/6	1.9 - 2.0 (2.0)	5/5	1.9 - 1.9 (1.9)	4/4	2 - 2.2 (2.1)	5/5	1.9 - 1.9 (1.9)		
Chromium	Discharge from steel and pulp mills; Erosion of natural deposits	ppb	100	MCL	15/16	ND - 2.0 (1.4)	5/5	1.2 - 1.3 (1.3)	5/5	0.88 - 0.98 (0.94)	6/6	0.89 - 0.98 (0.93)	5/5	1.3 - 1.4 (1.3)	4/4	1.6 - 1.7 (1.7)	0/5	-		

These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.

These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.





Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7	
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024	
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>
Copper	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	1,300	MCL	16/16	1.3 - 235 (81)	5/5	15 - 140 (66)	5/5	16 - 164 (70)	6/6	17 - 133 (44)	5/5	11 - 180 (76)	4/4	10.8 - 243 (91.5)	5/5	9.7 - 151 (46)	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Lead	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	15	MCL	15/16	ND - 1.7 (0.46)	4/5	ND - 1.8 (0.66)	5/5	0.24 - 0.95 (0.50)	6/6	0.13 - 3.7 (0.80)	5/5	0.13 - 1.6 (0.48)	3/4	ND - 0.54 (0.39) <sup>11</sup>	3/5	ND - 0.85 (0.41)		
Mercury	Erosion of natural deposits; Discharge from refineries and factories; Runoff from landfills; Runoff from cropland	ppb	2.0	MCL	0/16	-	0/5	-	0/5	-	1/6	ND - 0.025 (0.025)	0/5	-	0/4	-	0/5	-		
Selenium	Discharge from petroleum and metal refineries; Erosion of natural deposits; Discharge from mines	ppb	50	MCL	2/16	ND - 0.71 (0.52)	0/5	-	4/5	ND - 1.0 (0.85)	1/6	ND - 0.57 (0.57)	5/5	0.33 - 0.38 (0.36)	0/4	-	5/5	1.4 - 1.9 (1.7)		
Thallium	Leaching from ore-processing sites; Discharge from electronics, glass, and drug factories	ppb	2.0	MCL	3/16	ND - 0.12 (0.087)	0/5	-	0/5	-	0/6	-	0/5	-	0/4	-	0/5	-		
<b>Volatile Organic Compounds (VOCs)</b>																				
Total trihalomethanes (sum of chloroform, bromoform, bromodichloromethane, and di-bromochloromethane)	By-product of drinking water disinfection	ppb	80	MCL	-	-	2/5	ND - 1.5 (1.2)	0/5	-	3/6	ND - 1.6 (1.0)	2/5	ND - 0.29 (0.29)	4/4	0.25 - 0.39 (0.31)	2/5	ND - 0.55 (0.47)	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
<b>Synthetic Organic Compounds (SOCs) or Semi-Volatile Organic Compounds (SVOCs)</b>																				
Benzo(a)pyrene	Leaching from linings of water storage tanks and distribution lines	ppb	0.20	MCL	0/14	-	0/5	-	1/5	ND - 0.021 (0.021)	0/6	-	0/5	-	0/4	-	0/5	-	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Bis(2-ethylhexyl)phthalate	Discharge from rubber and chemical factories	ppb	6.0	MCL	1/16	ND - 2.2 (2.2)	0/5	-	1/5	ND - 0.59 (0.59)	0/6	-	0/5	-	1/4	ND - 0.44 (0.44)	0/5	-		

- Notes:
1. These contaminants are listed whether detected or non-detect (ND) because these are incident specific. All other contaminants are only listed if detected.
  2. The DOH uses multiple criteria to assess the safety of the drinking water including maximum contaminant levels (MCLs), previously established environmental action levels (EALs), and incident specific parameters (ISPs).
  3. These numbers are the minimum and maximum values from all the sample test results. The average (or mathematical mean) includes all sample test results with a detectable contaminant. An average is the sum of the results (excluding non-detects) divided by the total number results with detection only. Acronyms and explanation of terms used in this table are presented on the following pages.
  4. For more information regarding Total Petroleum Hydrocarbons, refer to the FACT SHEET What Are Petroleum Hydrocarbons?, available online at: [https://health.hawaii.gov/about/files/2021/12/21.12.16\\_What-Are-Petroleum-Hydrocarbons.pdf](https://health.hawaii.gov/about/files/2021/12/21.12.16_What-Are-Petroleum-Hydrocarbons.pdf).
  5. Total Organic Carbon (TOC) test results report any constituent containing carbon, many of which are naturally occurring and some of which may be man-made. The DOH had previously selected a TOC project screening level of 2,000 ppb under Stage 4. Each exceedance was investigated by reviewing the associated water quality data (e.g., BTEX results, TPH) and the IDWST determined that all TOC exceedances were inconclusive in association with petroleum hydrocarbons. Under the Drinking Water Long Term Monitoring Plan (under review during the LTM Period 3 report for Zone F1), DOH revised the TOC screening level to 4,000 ppb (previously 2,000 ppb).
  6. Parts per billion (ppb) refers to the amount (or concentration) of a contaminant in the water.
  7. Cells highlighted in green indicate the water sample results were below DOH Screening Levels.
  8. On January 30 and February 25, 2022, DOH revised the LTM requirements to include the analysis of free chlorine. Chlorine is typically used as an additive to drinking water for disinfection purposes.
  9. This does not include the Stage 4 January 15, 2022 and January 17, 2022 (initial) beryllium results from Pearl Harbor Elementary (Field Sample Numbers: 220115F1DT03, 220117F1DT05). This does include the resampled results from Pearl Harbor Elementary. This exceedance was associated with Premise Plumbing and is not associated with the JBPHH water distribution system. Therefore, it was not included in this table.
    - a. The sample result taken Pearl Harbor Elementary on January 15, 2022 was 5.7 parts per billion (ppb) for beryllium. This was in exceedance of the MCL of 4 ppb. Investigation into this matter determined that value was laboratory-estimated due to interference. IDWST members directed that the school location be flushed again and sampled again to confirm that it was interference during laboratory analysis. The resamples were both non-detect.
  10. Per the June 2022 Drinking Water Long-Term Monitoring Plan, the ISP for Total TPHs was changed to 266 ppb (previously it was 211 ppb). The June 2022 Drinking Water Long-Term Monitoring Plan is available online at: <https://health.hawaii.gov/about/files/2022/08/JBPHH-Drinking-Water-LTM-Plan-FINAL-20220823.pdf>.
  11. This does not include February 21, 2023 lead result an outdoor sink at Pearl Harbor Elementary School Building J, Room 40 (Field Sample Number: F1-TW-0017726-22340-N-1). This exceedance is associated with premise plumbing and is not associated with the JBPHH water distribution system. Therefore, it was not included in this table. For more information on this exceedance please see the Data Summary for Zone F1 LTM Period 5 posted on the Safe Waters website at: <https://jbphh-safewaters.org>.
    - a. The sample result collected from an outdoor sink at Pearl Harbor Elementary School Building J, Room 40 on February 21, 2023 was 17 ppb for lead. This was an exceedance of the action level of 15 ppb. Investigation into this exceedance determined that although it was likely to be a premise plumbing issue, further investigation was warranted through additional sampling. The school was immediately notified and the faucet was secured. The faucet has been added to the Hawaii Department of Education fixture replacement program. Once the fixture has been replaced, the faucet will be flushed and resampled.



**Table 1-3. Contaminants Detected in Drinking Water Samples Collected from Child Development Centers in Zone F1**

Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7		
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024		
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples
<b>Contaminants of Concern<sup>1</sup></b>																					
Benzene	Discharge from factories; Leaching from gas storage tanks and landfills	ppb <sup>6</sup>	5.0	MCL	-	-	0/5	-	0/5	-	0/2	-	0/2	-	0/2	-	0/2	-	0/2	-	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.
Ethylbenzene	Discharge from petroleum refineries	ppb	700	MCL	-	-	0/5	-	0/5	-	0/2	-	0/2	-	0/2	-	0/2	-	0/2	-	
Toluene	Discharge from petroleum factories	ppb	1,000	MCL	-	-	0/5	-	0/5	-	0/2	-	0/2	-	0/2	-	0/2	-	0/2	-	
Xylenes (Total)	Discharge from petroleum factories; Discharge from chemical factories	ppb	10,000	MCL	-	-	0/5	-	0/5	-	0/2	-	0/2	-	0/2	-	0/2	-	0/2	-	
1-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also, present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites.	ppb	10	EAL	-	-	0/5	-	0/5	-	0/2	-	0/2	-	0/2	-	0/2	-	0/2	-	
2-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also used to make vitamin K; and is present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites	ppb	10	EAL	-	-	0/5	-	0/5	-	0/2	-	0/2	-	0/2	-	0/2	-	0/2	-	
Naphthalene	Naphthalene is found in coal tar or crude oil and is used in the manufacture of plastics, resins, fuels, and dyes, and as a fumigant	ppb	17	EAL	-	-	0/5	-	0/5	-	0/2	-	0/2	-	0/2	-	0/2	-	0/2	-	
Total TPH <sup>4</sup>	TPH is petroleum and can contaminate drinking water through spills and other releases into the environment	ppb	266 <sup>10</sup>	ISP	-	-	0/5	-	0/5	-	1/2	ND - 118 (118)	0/2	-	0/2	-	2/2	58 - 65 (62)	-	-	
Total Organic Carbon (TOC) <sup>5</sup>	Naturally present in the environment, but also can be an indicator of contamination, including petroleum or other sources	ppb	4,000	ISP	-	-	0/5	-	0/5	-	0/2	-	0/2	-	0/2	-	0/2	-	0/2	-	
Free Chlorine (Field Test) <sup>8</sup>	Water additive used to control microbes	ppb	4,000	ISP	-	-	6/6	480 - 670 (588)	5/5	480 - 560 (522)	2/2	410 - 470 (440)	2/2	370 - 500 (435)	2/2	290 - 380 (335)	2/2	40 - 160 (100)	-	-	
<b>Metals</b>																					
Antimony	Discharge from petroleum refineries; fire retardants; ceramics; electronics; solder	ppb	6.0	MCL	-	-	0/6	-	1/5	ND - 0.19 (0.19)	0/2	-	0/2	-	0/2	-	0/2	-	0/2	-	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.



Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7	
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024	
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>
Barium	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits	ppb	2,000	MCL	-	-	6/6	1.9 - 2.1 (2.0)	5/5	1.9 - 2.1 (2.0)	2/2	2.1 - 2.1 (2.1)	2/2	2.0 - 2.2 (2.1)	2/2	1.9 - 2.0 (2.0)	2/2	2.0 - 2.0 (2.0)	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Chromium	Discharge from steel and pulp mills; Erosion of natural deposits	ppb	100	MCL	-	-	6/6	1.4 - 1.7 (1.6)	5/5	1.2 - 1.3 (1.3)	2/2	1.3 - 1.3 (1.3)	2/2	2.1 - 2.2 (2.2)	2/2	1.7 - 1.7 (1.7)	2/2	0.66 - 0.68 (0.67)		
Copper	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	1,300	MCL	-	-	6/6	1.5 - 11.9 (4.7)	5/5	0.86 - 14 (4.1)	2/2	1.6 - 25 (13)	2/2	4.5 - 4.8 (4.7)	2/2	4.7 - 4.9 (4.8)	2/2	5.4 - 7.0 (6.2)		
Lead	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	15	MCL	-	-	2/6	ND - 0.2 (0.2) <sup>9</sup>	1/5	ND - 0.13 (0.13)	0/2	-	1/2	ND - 0.19 (0.19)	0/2	-	1/2	ND - 0.14 (0.14)		
Mercury	Erosion of natural deposits; Discharge from refineries and factories; Runoff from landfills; Runoff from cropland	ppb	2.0	MCL	-	-	0/6	-	0/5	-	0/2	-	0/2	-	0/2	-	1/2	ND - 0.034 (0.034)		
Selenium	Discharge from petroleum and metal refineries; Erosion of natural deposits; Discharge from mines	ppb	50	MCL	-	-	0/6	-	1/5	ND - 0.82 (0.82)	2/2	1.2 - 1.5 (1.4)	0/2	-	0/2	-	2/2	1.9 - 2.3 (2.1)		
Thallium	Leaching from ore-processing sites; Discharge from electronics, glass, and drug factories	ppb	2.0	MCL	-	-	0/6	-	0/5	-	1/2	ND - 0.071 (0.071)	0/2	-	0/2	-	0/2	-		
<b>Volatile Organic Compounds (VOCs)</b>																				
Total trihalomethanes (sum of chloroform, bromoform, bromodichloromethane, and di-bromochloromethane)	By-product of drinking water disinfection	ppb	80	MCL	-	-	0/5	-	0/5	-	1/2	ND - 0.57 (0.57)	0/2	-	2/2	0.68 - 0.75 (0.72)	2/2	0.87 - 0.96 (0.92)	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
<b>Synthetic Organic Compounds (SOCs) or Semi-Volatile Organic Compounds (SVOCs) - ND</b>																				

- Notes:
- These contaminants are listed whether detected or non-detect (ND) because these are incident specific. All other contaminants are only listed if detected.
  - The DOH uses multiple criteria to assess the safety of the drinking water including maximum contaminant levels (MCLs), previously established environmental action levels (EALs), and incident specific parameters (ISPs).
  - These numbers are the minimum and maximum values from all the sample test results. The average (or mathematical mean) includes all sample test results with a detectable contaminant. An average is the sum of the results (excluding non-detects) divided by the total number results with detection only. Acronyms and explanation of terms used in this table are presented on the following pages.
  - For more information regarding Total Petroleum Hydrocarbons, refer to the FACT SHEET What Are Petroleum Hydrocarbons?, available online at: [https://health.hawaii.gov/about/files/2021/12/21.12.16\\_What-Are-Petroleum-Hydrocarbons.pdf](https://health.hawaii.gov/about/files/2021/12/21.12.16_What-Are-Petroleum-Hydrocarbons.pdf).
  - Total Organic Carbon (TOC) test results report any constituent containing carbon, many of which are naturally occurring and some of which may be man-made. The DOH had previously selected a TOC project screening level of 2,000 ppb under Stage 4. Each exceedance was investigated by reviewing the associated water quality data (e.g., BTEX results, TPH) and the IDWST determined that all TOC exceedances were inconclusive in association with petroleum hydrocarbons. Under the Drinking Water Long Term Monitoring Plan (under review during the LTM Period 3 report for Zone F1), DOH revised the TOC screening level to 4,000 ppb (previously 2,000 ppb).
  - Parts per billion (ppb) refers to the amount (or concentration) of a contaminant in the water.
  - Cells highlighted in green indicate the water sample results were below DOH Screening Levels.
  - On January 30 and February 25, 2022, DOH revised the LTM requirements to include the analysis of free chlorine. Chlorine is typically used as an additive to drinking water for disinfection purposes.
  - This does not include the sample result collected from Moanalua Pre-School (Sample ID: F1-TW-0014170-22070-N-3) collected on March 29, 2022 (initial). The lead sample result collected from Moanalua Pre-School on March 29, 2022 was 33.4 ppb. This was an exceedance of the action level of 15 ppb. This exceedance was associated with Premise Plumbing and is not associated with the JBPHH water distribution system. Therefore, it was not included in this table. For more information on this exceedance please see the Data Summary for Zone F1 LTM Period 1 posted on the Safe Waters website at: <https://jbphh-safewaters.org>.
    - Investigation into this exceedance determined that although it was likely to be a premise plumbing issue, further investigation was warranted through additional sampling. The fixture at the sink where the exceedance was reported was replaced with a new fixture. The faucet was flushed and re-sampled. Results of the re-sample (Sample ID: F1-TW-0014170-22070-N-3-R1) was non-detect for lead.
  - Per the June 2022 Drinking Water Long-Term Monitoring Plan, the ISP for Total TPHs was changed to 266 ppb (previously it was 211 ppb). The June 2022 Drinking Water Long-Term Monitoring Plan is available online at: <https://health.hawaii.gov/about/files/2022/08/JBPHH-Drinking-Water-LTM-Plan-FINAL-20220823.pdf>.



**Table 1-4. Contaminants Detected in Drinking Water Samples Collected from Other Buildings in Zone F1**

Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7	
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024	
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>
<b>Contaminants of Concern<sup>1</sup></b>																				
Benzene	Discharge from factories; Leaching from gas storage tanks and landfills	ppb <sup>6</sup>	5.0	MCL	0/10	-	0/8	-	0/8	-	0/7	-	0/11	-	0/11	-	0/8	-		
Ethylbenzene	Discharge from petroleum refineries	ppb	700	MCL	0/10	-	0/8	-	0/8	-	0/7	-	0/11	-	0/11	-	0/8	-		
Toluene	Discharge from petroleum factories	ppb	1,000	MCL	0/10	-	0/8	-	0/8	-	0/7	-	0/11	-	0/11	-	0/8	-		
Xylenes (total)	Discharge from petroleum factories; Discharge from chemical factories	ppb	10,000	MCL	0/10	-	0/8	-	0/8	-	0/7	-	0/11	-	0/11	-	0/8	-		
1-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also, present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites.	ppb	10	EAL	0/10	-	0/8	-	0/8	-	0/7	-	0/11	-	0/11	-	0/8	-		
2-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also used to make vitamin K; and is present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites	ppb	10	EAL	0/10	-	0/8	-	0/8	-	0/7	-	0/11	-	0/11	-	0/8	-		
Naphthalene	Naphthalene is found in coal tar or crude oil and is used in the manufacture of plastics, resins, fuels, and dyes, and as a fumigant	ppb	17	EAL	0/10	-	0/8	-	0/8	-	0/7	-	0/11	-	0/11	-	0/8	-		
Total TPH <sup>4</sup>	TPH is petroleum and can contaminate drinking water through spills and other releases into the environment	ppb	266 <sup>9</sup>	ISP	0/10	-	0/8	-	0/8	-	1/7	ND - 66 (66)	5/11	ND - 78 (64)	7/11	ND - 72 (59)	1/8	ND - 88 (88)		
Total Organic Carbon (TOC) <sup>5</sup>	Naturally present in the environment, but also can be an indicator of contamination, including petroleum or other sources	ppb	4,000	ISP	5/10	ND - 3,740 (2,534)	0/8	-	0/8	-	0/7	-	0/11	-	0/11	-	0/8	-		
Free Chlorine (Field Test) <sup>8</sup>	Water additive used to control microbes	ppb	4,000	ISP	-	-	8/8	10 - 1,030 (539)	7/7	20 - 600 (363)	7/7	110 - 570 (367)	11/11	10 - 750 (378)	11/11	220 - 530 (420)	8/8	60 - 720 (325)		
<b>Metals</b>																				
Antimony	Discharge from petroleum refineries; fire retardants; ceramics; electronics; solder	ppb	6.0	MCL	0/10	-	0/8	-	1/8	ND - 0.13 (0.13)	2/7	ND - 0.26 (0.19)	1/11	ND - 0.16 (0.16)	0/11	-	0/8	-		
Arsenic	Erosion of natural deposits; Runoff from orchards; Runoff from glass and electronics production wastes	ppb	10	MCL	5/10	ND - 0.30 (0.27)	1/8	ND - 0.70 (0.70)	1/8	ND - 0.92 (0.92)	0/7	-	0/11	-	1/11	ND - 0.53 (0.53)	0/8	-		

These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.

These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.



Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7	
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024	
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>
Barium	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits	ppb	2,000	MCL	10/10	1.9 - 3.3 (2.5)	8/8	1.9 - 7.6 (2.8)	8/8	2.0 - 4.5 (2.4)	7/7	1.8 - 3.2 (2.2)	11/11	2 - 2.5 (2.2)	11/11	1.8 - 2.2 (2.0)	8/8	1.8 - 2.3 (2.0)	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Cadmium	By-product of drinking water disinfection	ppb	5.0	MCL	0/10	-	0/8	-	1/8	ND - 0.071 (0.071)	0/7	-	0/11	-	1/11	ND - 0.095 (0.095)	2/8	ND - 0.094 (0.074)		
Chromium	Discharge from steel and pulp mills; Erosion of natural deposits	ppb	100	MCL	10/10	1.1 - 1.8 (1.6)	7/8	ND - 1.7 (1.5)	7/8	ND - 1.1 (1.0)	7/7	0.78 - 1.3 (1.0)	11/11	1.8 - 2.1 (1.9)	11/11	1.5 - 2.3 (1.8)	8/8	0.65 - 0.98 (0.81)		
Copper	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	1,300	MCL	10/10	21 - 140 (58)	8/8	7.9 - 83 (33)	8/8	12 - 45 (23)	7/7	22 - 78 (40)	11/11	17 - 225 (65)	11/11	12 - 84 (33)	8/8	19 - 77 (38)		
Lead	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	15	MCL	7/10	ND - 0.39 (0.21)	6/8	ND - 3.1 (0.69)	4/8	ND - 0.53 (0.37)	6/7	ND - 2.2 (0.62)	9/11	ND - 0.9 (0.38) <sup>10</sup>	6/11	ND - 1.6 (0.83)	8/8	0.14 - 7.8 (1.2)		
Mercury	Erosion of natural deposits; Discharge from refineries and factories; Runoff from landfills; Runoff from cropland	ppb	2	MCL	0/10	-	0/8	-	0/8	-	0/7	-	1/11	ND - 0.025 (0.025)	0/11	-	1/8	ND - 0.027 (0.027)		
Selenium	Discharge from petroleum and metal refineries; Erosion of natural deposits; Discharge from mines	ppb	50	MCL	5/10	ND - 1.3 (1.1)	0/8	-	8/8	0.34 - 0.83 (0.55)	4/7	ND - 1.7 (1.1)	1/11	ND - 0.3 (0.3)	0/11	-	8/8	1.3 - 2.1 (1.6)		
Thallium	Leaching from ore-processing sites; Discharge from electronics, glass, and drug factories	ppb	2.0	MCL	0/10	-	1/8	ND - 0.058 (0.058)	0/8	-	1/7	ND - 0.16 (0.16)	0/11	-	0/11	-	0/8	-		
<b>Volatile Organic Compounds (VOCs)</b>																				
Total Haloacetic acids (sum of mono-, di-, trichloroacetic acids and mono- and dibromo acetic acids)	By-product of drinking water disinfection	ppb	60	MCL	-	-	0/8	-	0/8	-	0/7	-	1/11	ND - 0.52 (0.52)	0/11	-	0/8	-	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Total trihalomethanes (sum of chloroform, bromoform, bromodichloromethane, and di-bromochloromethane)	By-product of drinking water disinfection	ppb	80	MCL	-	-	3/8	ND - 3.9 (1.8)	1/8	ND - 0.63 (0.63)	5/7	ND - 1.9 (0.98)	5/11	ND - 1.9 (1.1)	9/11	ND - 3.4 (0.73)	1/8	ND - 0.29 (0.29)		
<b>Synthetic Organic Compounds (SOCs) or Semi-Volatile Organic Compounds (SVOCs) - ND</b>																				

Notes:

1. These contaminants are listed whether detected or non-detect (ND) because these are incident specific. All other contaminants are only listed if detected.
2. The DOH uses multiple criteria to assess the safety of the drinking water including maximum contaminant levels (MCLs), previously established environmental action levels (EALs), and incident specific parameters (ISPs).
3. These numbers are the minimum and maximum values from all the sample test results. The average (or mathematical mean) includes all sample test results with a detectable contaminant. An average is the sum of the results (excluding non-detects) divided by the total number results with detection only. Acronyms and explanation of terms used in this table are presented on the following pages.
4. For more information regarding Total Petroleum Hydrocarbons, refer to the FACT SHEET What Are Petroleum Hydrocarbons?, available online at: [https://health.hawaii.gov/about/files/2021/12/21.12.16\\_What-Are-Petroleum-Hydrocarbons.pdf](https://health.hawaii.gov/about/files/2021/12/21.12.16_What-Are-Petroleum-Hydrocarbons.pdf).
5. Total Organic Carbon (TOC) test results report any constituent containing carbon, many of which are naturally occurring and some of which may be man-made. The DOH had previously selected a TOC project screening level of 2,000 ppb under Stage 4. Each exceedance was investigated by reviewing the associated water quality data (e.g., BTEX results, TPH) and the IDWST determined that all TOC exceedances were inconclusive in association with petroleum hydrocarbons. Under the Drinking Water Long Term Monitoring Plan (under review during the LTM Period 3 report for Zone F1), DOH revised the TOC screening level to 4,000 ppb (previously 2,000 ppb).
6. Parts per billion (ppb) refers to the amount (or concentration) of a contaminant in the water.
7. Cells highlighted in green indicate the water sample results were below DOH Screening Levels.
8. On January 30 and February 25, 2022, DOH revised the LTM requirements to include the analysis of free chlorine. Chlorine is typically used as an additive to drinking water for disinfection purposes.
9. Per the June 2022 Drinking Water Long-Term Monitoring Plan, the ISP for Total TPHs was changed to 266 ppb (previously it was 211 ppb). The June 2022 Drinking Water Long-Term Monitoring Plan is available online at: <https://health.hawaii.gov/about/files/2022/08/JBPHH-Drinking-Water-LTM-Plan-FINAL-20220823.pdf>.





10. This does not include the October 5, 2022 lead result from Building 2655, sanitation sink faucet (Field Sample Number: F1-TW-0015332-22160-N-1). This does include the resampled result of October 24, 2022 from Building 2655, sanitation sink faucet (Field Sample Number: F1-TW-0015332-22160-N-1-R1). This exceedance was associated with premise plumbing and is not associated with the JBPHH water distribution system. Therefore, it was not included in this table. For more information on this exceedance please see the Data Summary for Zone F1 LTM Period 4 posted on the Safe Waters website at: <https://jbphh-safewaters.org>.
- a) The sample result collected from Building 2655 on October 5, 2022 was 60 ppb for lead. This was an exceedance of the action level of 15 ppb. Investigation into this exceedance determined that although it was likely to be a premise plumbing issue, further investigation was warranted through additional sampling. The faucet was flushed and the re-sample result collected on October 24, 2022 at the original faucet was below the action level.



**Table 1-5. Contaminants Detected in Drinking Water Samples Collected from Fire Hydrants in Zone F1**

Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7	
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024	
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>
<b>Contaminants of Concern<sup>1</sup></b>																				
Benzene	Discharge from factories; Leaching from gas storage tanks and landfills	ppb <sup>6</sup>	5.0	MCL	0/7	-	0/9	-	0/9	-	0/9	-	0/11	-	0/10	-	0/9	-		
Ethylbenzene	Discharge from petroleum refineries	ppb	700	MCL	0/7	-	0/9	-	0/9	-	0/9	-	0/11	-	0/10	-	0/9	-		
Toluene	Discharge from petroleum factories	ppb	1,000	MCL	0/7	-	0/9	-	0/9	-	0/9	-	0/11	-	0/10	-	0/9	-		
Xylenes (Total)	Discharge from petroleum factories; Discharge from chemical factories	ppb	10,000	MCL	0/7	-	0/9	-	0/9	-	0/9	-	0/11	-	1/10	ND - 0.31 (0.31)	0/9	-		
1-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also, present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites.	ppb	10	EAL	0/7	-	0/9	-	0/9	-	0/9	-	0/11	-	0/10	-	0/9	-		
2-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also used to make vitamin K; and is present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites	ppb	10	EAL	0/7	-	0/9	-	0/9	-	0/9	-	0/11	-	0/10	-	0/9	-		
Naphthalene	Naphthalene is found in coal tar or crude oil and is used in the manufacture of plastics, resins, fuels, and dyes, and as a fumigant	ppb	17	EAL	1/7	ND - 0.039 (0.039)	0/9	-	0/9	-	0/9	-	0/11	-	0/10	-	0/9	-		
Total TPH <sup>4</sup>	TPH is petroleum and can contaminate drinking water through spills and other releases into the environment	ppb	266 <sup>9</sup>	ISP	1/7	ND - 56 (56)	0/9	-	0/9	-	0/9	-	3/11	ND - 71 (61)	5/10	ND - 112 (75)	8/9	ND - 151 (100)		
Total Organic Carbon (TOC) <sup>5</sup>	Naturally present in the environment, but also can be an indicator of contamination, including petroleum or other sources	ppb	4,000	ISP	1/7	ND - 1,530 (1,530)	2/9	ND - 620 (615)	0/9	-	0/9	-	0/11	-	1/10	ND - 230 (230)	0/9	-		
Free Chlorine (Field Test) <sup>8</sup>	Water additive used to control microbes	ppb	4,000	ISP	-	-	8/8	20 - 660 (479)	8/8	20 - 510 (356)	8/8	20 - 560 (376)	8/8	40 - 520 (329)	8/8	20 - 510 (388)	8/8	30 - 770 (515)		
<b>Metals</b>																				
Antimony	Discharge from petroleum refineries; fire retardants; ceramics; electronics; solder	ppb	6.0	MCL	1/7	ND - 0.13 (0.13)	1/9	ND - 0.11 (0.11)	0/9	-	0/9	-	0/11	-	0/10	-	3/9	ND - 0.14 (0.13)		
Arsenic	Erosion of natural deposits; Runoff from orchards; Runoff from glass and electronics production wastes	ppb	10	MCL	6/7	ND - 0.36 (0.28)	0/9	-	0/9	-	0/9	-	0/11	-	1/10	ND - 0.50 (0.50)	0/9	-		

These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.

These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.



Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Stage 4 Sampling Summary		Stage 5 LTM Sampling Summary Period 1		Stage 5 LTM Sampling Summary Period 2		Stage 5 LTM Sampling Summary Period 3		Stage 5 LTM Sampling Summary Period 4		Stage 5 LTM Sampling Summary Period 5		Stage 5 LTM Sampling Summary Period 6		Stage 5 LTM Sampling Summary Period 7	
					February 2022		April 2022		May 2022		June 2022		December 2022		June 2023		December 2023		March 2024	
					No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>	No. of Detects out of Samples	Minimum - Maximum (Average) <sup>3</sup>
Barium	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits	ppb	2,000	MCL	7/7	2.0 - 4.2 (2.7)	9/9	1.8 - 3.4 (2.3)	9/9	1.9 - 3.5 (2.3)	9/9	1.9 - 3.5 (2.4)	11/11	2.0 - 4.0 (2.5)	10/10	1.8 - 3.4 (2.2)	9/9	2.0 - 4.4 (2.5)	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Chromium	Discharge from steel and pulp mills; Erosion of natural deposits	ppb	100	MCL	7/7	0.68 - 1.8 (1.3)	9/9	0.97 - 1.6 (1.3)	8/9	ND - 0.89 (0.84)	8/9	ND - 1.0 (0.92)	11/11	0.85 - 1.9 (1.6)	10/10	1.1 - 2.1 (1.7)	8/9	ND - 2.0 (0.88)		
Copper	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	1,300	MCL	7/7	2.2 - 4.6 (3.3)	9/9	2.4 - 5.1 (3.6)	9/9	2.3 - 6.8 (3.9)	9/9	2.2 - 12 (5.5)	_10	_10	_10	_10	_10	_10		
Lead	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	15	MCL	7/7	0.37 - 1.0 (0.74)	9/9	0.24 - 1.1 (0.45)	9/9	0.18 - 2.2 (0.78)	9/9	0.32 - 1.3 (0.54)	_10	_10	_10	_10	_10	_10		
Selenium	Discharge from petroleum and metal refineries; Erosion of natural deposits; Discharge from mines	ppb	50	MCL	7/7	0.56 - 1.6 (1)	0/9	-	0/9	-	8/9	ND - 2.2 (1.9)	1/11	ND - 0.47 (0.47)	0/10	-	6/9	ND - 2.1 (1.8)		
Thallium	Leaching from ore-processing sites; Discharge from electronics, glass, and drug factories	ppb	2.0	MCL	1/7	ND - 0.042 (0.042)	1/9	ND - 0.059 (0.059)	0/9	-	0/9	-	2/11	ND - 0.058 (0.055)	0/10	-	2/9	ND - 0.11 (0.082)		
<b>Volatile Organic Compounds (VOCs)</b>																				
Total Haloacetic acids (sum of mono-, di-, trichloroacetic acids and mono- and dibromo acetic acids)	By-product of drinking water disinfection	ppb	60	MCL	-	-	1/9	ND - 1.1 (1.1)	0/9	-	0/9	-	1/11	ND - 0.57 (0.57)	0/10	-	0/9	-	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	
Total trihalomethanes (sum of chloroform, bromoform, bromodichloromethane, and di-bromochloromethane)	By-product of drinking water disinfection	ppb	80	MCL	-	-	9/9	0.57 - 12 (2.7)	5/9	ND - 14 (4.3)	9/9	0.51 - 11 (2.6)	11/11	0.35 - 5.4 (1.7)	10/10	0.37 - 1.3 (0.78)	8/9	ND - 3.4 (1.1)		
<b>Synthetic Organic Compounds (SOCs) or Semi-Volatile Organic Compounds (SVOCs)</b>																				
Benzo(a)pyrene	Leaching from linings of water storage tanks and distribution lines	ppb	0.2	MCL	0/20	-	0/9	-	0/9	-	0/9	-	0/11	-	1/10	ND - 0.011 (0.011)	0/9	-	These samples will be collected 24 months after the health advisory was amended. Results will be reported in a LTM Period 7 Sampling Results Report.	

- Notes:
1. These contaminants are listed whether detected or non-detect (ND) because these are incident specific. All other contaminants are only listed if detected.
  2. The DOH uses multiple criteria to assess the safety of the drinking water including maximum contaminant levels (MCLs), previously established environmental action levels (EALs), and incident specific parameters (ISPs).
  3. These numbers are the minimum and maximum values from all the sample test results. The average (or mathematical mean) includes all sample test results with a detectable contaminant. An average is the sum of the results (excluding non-detects) divided by the total number results with detection only. Acronyms and explanation of terms used in this table are presented on the following pages.
  4. For more information regarding Total Petroleum Hydrocarbons, refer to the FACT SHEET What Are Petroleum Hydrocarbons?, available online at: [https://health.hawaii.gov/about/files/2021/12/21\\_12.16\\_What-Are-Petroleum-Hydrocarbons.pdf](https://health.hawaii.gov/about/files/2021/12/21_12.16_What-Are-Petroleum-Hydrocarbons.pdf).
  5. Total Organic Carbon (TOC) test results report any constituent containing carbon, many of which are naturally occurring and some of which may be man-made. The DOH had previously selected a TOC project screening level of 2,000 ppb under Stage 4. Each exceedance was investigated by reviewing the associated water quality data (e.g., BTEX results, TPH) and the IDWST determined that all TOC exceedances were inconclusive in association with petroleum hydrocarbons. Under the Drinking Water Long Term Monitoring Plan (under review during the LTM Period 3 report for Zone F1), DOH revised the TOC screening level to 4,000 ppb (previously 2,000 ppb).
  6. Parts per billion (ppb) refers to the amount (or concentration) of a contaminant in the water.
  7. Cells highlighted in green indicate the water sample results were below DOH Screening Levels.
  8. On January 30 and February 25, 2022, DOH revised the LTM requirements to include the analysis of free chlorine. Chlorine is typically used as an additive to drinking water for disinfection purposes.
  9. Per the June 2022 Drinking Water Long-Term Monitoring Plan, the ISP for Total TPHs was changed to 266 ppb (previously it was 211 ppb). The June 2022 Drinking Water Long-Term Monitoring Plan is available online at: <https://health.hawaii.gov/about/files/2022/08/JBPHH-Drinking-Water-LTM-Plan-FINAL-20220823.pdf>.



- 
10. Per the June 2022 Drinking Water Long-Term Monitoring Plan, Lead and Copper samples will only be collected from residences, other buildings, and the entry points to the distribution system during LTM Months 4-24. The June 2022 Drinking Water Long-Term Monitoring Plan is available online at: <https://health.hawaii.gov/about/files/2022/08/JPBPHH-Drinking-Water-LTM-Plan-FINAL-20220823.pdf>.



**Table 1-6. Contaminants Detected in Drinking Water Samples Collected from JBPHH’s Source Water (Waiawa Shaft - Post Chlorination)**

Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Sampling Period: January 2022			Sampling Period: June 2022			Sampling Period: December 2022			Sampling Period: February 2023			Sampling Period: July 2023		
					No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)	No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)	No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)	No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)	No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)
<b>Contaminants of Concern<sup>1</sup></b>																			
Benzene	Discharge from factories; Leaching from gas storage tanks and landfills	ppb <sup>4</sup>	5.0	MCL	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
Ethylbenzene	Discharge from petroleum refineries	ppb	700	MCL	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
Toluene	Discharge from petroleum factories	ppb	1,000	MCL	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
m,p,o-Xylenes	Discharge from petroleum factories; Discharge from chemical factories	ppb	10,000	MCL	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
1-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also, present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites	ppb	10	ISP	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
2-Methylnaphthalene	Used to make other chemicals such as dyes, and resins; also used to make vitamin K; and is present in cigarette smoke, wood smoke, tar, asphalt, and at some hazardous waste sites	ppb	10	ISP	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
Naphthalene	Naphthalene is found in coal tar or crude oil and is used in the manufacture of plastics, resins, fuels, and dyes, and as a fumigant	ppb	17	ISP	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
Total Petroleum Hydrocarbons (TPHs)	TPH is petroleum and can contaminate drinking water through spills and other releases into the environment	ppb	266 <sup>9</sup>	ISP	0/1	-	Yes <sup>3</sup>	0/1	-	Yes	0/1	-	Yes	1/1	61	Yes	0/2	-	Yes
Total Organic Carbon (TOC) <sup>4</sup>	Naturally present in the environment, but also can be an indicator of contamination, including petroleum or other sources	ppb	4,000	ISP	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
Free Chlorine (Field Test) <sup>8</sup>	Water Additive	ppb	4,000	MCL	-	-	-	1/1	670	Yes	-	-	-	-	-	-	1/1	650	Yes
<b>Metals</b>																			
Antimony	Discharge from petroleum refineries; fire retardants; ceramics; electronics; solder	ppb	6.0	MCL	1/1	0.092	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
Arsenic	Erosion of natural deposits; Runoff from orchards; Runoff from glass and electronics production waste	ppb	10	MCL	1/1	0.027	Yes	0/1	-	Yes	0/1	-	Yes	0/1	-	Yes	0/2	-	Yes
Barium	Discharge of drilling wastes; Discharge from metal refineries; Erosion of natural deposits	ppb	2,000	MCL	1/1	1.7	Yes	1/1	1.7	Yes	1/1	2.2	Yes	1/1	1.9	Yes	2/2	1.7 - 1.7 (1.7)	Yes
Chromium	Corrosion of galvanized pipes; Erosion of natural deposits; Discharge from metal refineries; Runoff from waste batteries and paints	ppb	100	MCL	1/1	1.5	Yes	1/1	0.55	Yes	1/1	1.2	Yes	1/1	1.6	Yes	2/2	0.70 - 0.80 (0.75)	Yes
Copper	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	1,300	EAL	1/1	21	Yes	1/1	19	Yes	1/1	15	Yes	1/1	22	Yes	2/2	12 - 16 (14)	Yes
Lead	Corrosion of household plumbing systems; Erosion of natural deposits	ppb	15	EAL	1/1	0.27	Yes	1/1	0.23	Yes	1/1	0.29	Yes	1/1	0.29	Yes	2/2	0.15 - 0.28 (0.22)	Yes
Selenium	Discharge from petroleum and metal refineries; Erosion of natural deposits; Discharge from mines	ppb	50	MCL	1/1	0.70	Yes	1/1	1.3	Yes	1/1	1.3	Yes	0/1	-	Yes	2/2	2.6 - 2.7 (2.7)	Yes
Thallium	Leaching from ore-processing sites; Discharge from electronics, glass, and drug factories	ppb	2	MCL	-	-	-	0/1	-	Yes	1/1	0.076	Yes	0/1	-	Yes	0/2	-	Yes





Contaminant	Typical Source of Contaminant	Units	DOH Project Screening Level	Basis of DOH Screening Level <sup>2</sup>	Sampling Period: January 2022			Sampling Period: June 2022			Sampling Period: December 2022			Sampling Period: February 2023			Sampling Period: July 2023		
					No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)	No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)	No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)	No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)	No. of Detects out of Samples	Level Detected <sup>3</sup>	Meets DOH Screening Level? (Yes / No)
<b>Volatile Organic Compounds (VOCs) – ND</b>																			
<b>Synthetic Organic Compounds (SOCs) or Sem-Volatile Organic Compounds (SVOCs)</b>																			
Bis(2-ethylhexyl)phthalate	Discharge from rubber and chemical factories	ppb	6.0	MCL	0/1	-	Yes	1/1	0.52	Yes	1/1	0.55	Yes	0/1	-	Yes	2/2	0.61 - 0.67 (0.64)	Yes

Notes:

1. These contaminants are listed whether detected or non-detect (ND) because these are incident specific. All other contaminants are only listed if detected.
2. The DOH uses multiple criteria to assess the safety of the drinking water including maximum contaminant levels (MCLs), previously established environmental action levels (EALs), and incident specific parameters (ISPs).
3. These numbers are the minimum and maximum values from all the sample test results. The average (or mathematical mean) includes all sample test results with a detectable contaminant. An average is the sum of the results (excluding non-detects) divided by the total number results with detection only. Acronyms and explanation of terms used in this table are presented on the following pages.
4. For more information regarding Total Petroleum Hydrocarbons, refer to the FACT SHEET What Are Petroleum Hydrocarbons?, available online at: [https://health.hawaii.gov/about/files/2021/12/21.12.16\\_What-Are-Petroleum-Hydrocarbons.pdf](https://health.hawaii.gov/about/files/2021/12/21.12.16_What-Are-Petroleum-Hydrocarbons.pdf).
5. Total Organic Carbon (TOC) test results report any constituent containing carbon, many of which are naturally occurring and some of which may be man-made. The DOH had previously selected a TOC project screening level of 2,000 ppb under Stage 4. Each exceedance was investigated by reviewing the associated water quality data (e.g., BTEX results, TPH) and the IDWST determined that all TOC exceedances were inconclusive in association with petroleum hydrocarbons. Under the Drinking Water Long Term Monitoring Plan (under review during the LTM Period 3 report for Zone F1), DOH revised the TOC screening level to 4,000 ppb (previously 2,000 ppb).
6. Parts per billion (ppb) refers to the amount (or concentration) of a contaminant in the water.
7. Cells highlighted in green indicate the water sample results were below DOH Screening Levels.
8. On January 30 and February 25, 2022, DOH revised the LTM requirements to include the analysis of free chlorine. Chlorine is typically used as an additive to drinking water for disinfection purposes.
9. Per the June 2022 Drinking Water Long-Term Monitoring Plan, the ISP for Total TPHs was changed to 266 ppb (previously it was 211 ppb). The June 2022 Drinking Water Long-Term Monitoring Plan is available online at: <https://health.hawaii.gov/about/files/2022/08/JBPHH-Drinking-Water-LTM-Plan-FINAL-20220823.pdf>.



## **Drinking Water Distribution System Recovery Plan: Stage 5 LTM Period 6 Sampling Results Report for Zone F1**

### **What is the purpose of this Stage 5 LTM Period 6 Sampling Results Report?**

This progress report presents the testing results from drinking water samples that have been collected from residences, schools, Child Development Centers, other buildings, fire hydrants, and from JBPHH's Source Water (Waiawa Shaft - Post Chlorination). These samples were collected after the health advisory had been amended and DOH determined drinking water was safe for human consumption. The health advisory was amended after the first four stages of the Drinking Water Distribution System Recovery Plan<sup>3</sup> were completed in your zone. The JBPHH PWS #HI0000360 is committed to ensuring tap water is safe for human consumption after residents have returned home.

We are sharing this information with you to keep you updated on your community's water quality.

### **What was found?**

The tables on the previous pages present all contaminants that were detected in drinking water samples that have been collected from residences, schools, Child Development Centers, other buildings, and fire hydrants in your zone during Stage 5 LTM Period 1, LTM Period 2, LTM Period 3, LTM Period 4, LTM Period 5, and LTM Period 6. The DOH used multiple standards/criteria (called DOH Project Screening Levels) to assess the safety of the drinking water to include:

- EPA and Hawaii DOH Maximum Contaminant Levels (MCLs) standards for drinking water;
- Previously established Environmental Action Levels (EALs); and
- Incident Specific Parameters (ISPs).

This report together with the data demonstrates that the drinking water in your area (Zone F1) meets U.S. EPA and DOH standards that are applicable to the Navy Water System Incident.

All exceedances of DOH Project Screening Levels are thoroughly reviewed and investigated by the Navy, Army, and DOH, to (1) determine if the exceedance is associated with the JBPHH water distribution system or if it is associated with premise plumbing (i.e., it is localized to a specific faucet) and (2) determine the appropriate course of action to address the exceedance (e.g., re-flushing).

---

<sup>3</sup> Drinking Water Distribution System Recovery Plan: <https://www.cpf.navy.mil/Portals/52/Drinking-Water-Distribution-System-Recovery-Plan.pdf>



There were no exceedances of screening levels in drinking water samples collected from residences, schools, Child Development Centers, other buildings, and fire hydrants during LTM Period 1, LTM Period 2, or LTM Period 3 for Zone F1.

The Following Premise Plumbing Exceedance was detected (and was investigated/addressed) in Zone F1 during LTM Period 1:

Exceedance Location	Plumbing Fixture	Contaminant	Initial Result	Action Taken	Final Result
Moanaula Pre-School <sup>1</sup>	Staff Bathroom Faucet	Lead	33.4 ppb	Replaced Fixture	Non-Detect

1. Moanalua Pre-School (Premise Plumbing Exceedance) The sample result collected from Moanalua Pre-School on March 29, 2022 was 33.4ppb for lead (Field Sample Number F1-TW-0014170-22070-N-3). This was an exceedance of the action level of 15 ppb. Investigation into this exceedance determined that it was likely to be a premise plumbing issue and the fixture should be replaced. The re-sample results collected following fixture replacement on April 28, 2022 were non-detect (Field Sample Number F1-TW-0014170-22070-N-3-R1). The pre-school was notified on April 8, 2022 and the fixture was immediately secured until re-sampling results were received.

The Following Premise Plumbing Exceedance was detected (and was investigated/addressed) in Zone F1 during LTM Period 4:

Exceedance Location	Plumbing Fixture	Contaminant	Initial Result	Action Taken	Final Result
Building 2655, Food/Service Stores <sup>1</sup>	Sanitation Sink Faucet	Lead	60 ppb	Fixture Flushed	0.30 pb

1. Building 2655, Food/Service Stores (Premise Plumbing Exceedance)

The sample result collected from Building 2655, Food/Service Stores on October 5, 2022 was 60 ppb for lead. This was an exceedance of the action level of 15 ppb. Investigation into this exceedance determined that although it was likely to be a premise plumbing issue, further investigation was warranted through additional sampling. The faucet was flushed for resampling and the business was notified, although it had been closed for a month for renovations. The re-sample collected on October 24, 2022 was below the action level. The business was notified of the re-sample results.

The Following Premise Plumbing Exceedance was detected (and was investigated/addressed) in Zone F1 during LTM Period 5:

Exceedance Location	Plumbing Fixture	Contaminant	Initial Result	Action Taken	Final Result
---------------------	------------------	-------------	----------------	--------------	--------------



Pearl Harbor Elementary Building J, Room 40 <sup>1</sup>	Outdoor Sink Faucet	Lead	17 ppb	Secured; added to Hawaii Department of Education fixture replacement program.	--
--	---------------------	------	--------	---	----

1. Pearl Harbor Elementary Building J, Room 40 (Premise Plumbing Exceedance)

The sample result collected from an outdoor sink at Pearl Harbor Elementary Building J, Room 40 on February 21, 2023 was 17 ppb for lead. This exceeded the action level of 15 ppb. Investigation into this exceedance determined that although it was likely to be a premise plumbing issue, further investigation was warranted through additional sampling. The school was immediately notified and the faucet was secured. The faucet has been added to the Hawaii Department of Education fixture replacement program. Once the fixture has been replaced, the faucet will be flushed and resampled.

The Following Premise Plumbing Exceedance was detected (and was investigated/addressed) in Zone F1 during LTM Period 6:

Exceedance Location	Plumbing Fixture	Contaminant	Initial Result	Action Taken	Final Result
4933 Kidd Court	Indoor Faucet	Lead	16.6 ppb	Fixture Flushed	0.23 ppb

1. 4933 Kidd Court (Premise Plumbing Exceedance)

The sample result collected from 4933 Kidd Court on August 28, 2023 was 16.6 ppb for lead. This exceeded the action level of 15 ppb. Investigation into this exceedance determined that although it was likely to be a premise plumbing issue, further investigation was warranted through additional sampling. The residence was notified and provided bottled water. The faucet and three additional faucets in the residence were flushed and resampled on September 6, 2023. All results were below the action level. The residence was notified of the resample results.

Total Organic Carbon (TOC) test results report any constituent containing carbon, many of which are naturally occurring and some of which may be man-made. The DOH selected a TOC project screening level of 4,000 parts per billion (ppb) for long term monitoring. Each exceedance is investigated by reviewing the associated water quality data (e.g., Disinfection byproducts and TPH results) for association with petroleum hydrocarbons. No TOC exceedances occurred in LTM Period 1, LTM Period 2, LTM Period 3, LTM Period 4, LTM Period 5, or LTM Period 6 for Zone F1.



## What contaminants were tested?

Drinking water, including bottled water, can contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants tested can be obtained by calling the Hawaii DOH Safe Drinking Water Branch at 808-586-4258.

In order to ensure that drinking water is safe to drink, EPA and Hawaii DOH regulate the amount of certain contaminants in water provided by public water systems. For this incident, the primary categories of monitored contaminants include Volatile Organic Compounds (VOCs), Synthetic Organic Chemicals (SOCs)/Semi-Volatile Organic Compounds (SVOCs), metals, Total Petroleum Hydrocarbons (TPH), and Total Organic Carbon (TOC). A description of these contaminant categories can be found under *Explanation of Terms* located at the end of this report. The full list of contaminants that were tested for this zone are presented in the laboratory reports that are located at: <https://jbphh-safewaters.org>. For complete information on the interagency response, please visit: <https://www.cpf.navy.mil/JPBHH-Water-Updates/>.

## What happened leading up to the public health advisory being issued?

The Red Hill Bulk Fuel Storage Facility jet fuel spill event was reported to have taken place on November 20, 2021. Subsequent reporting of fuel-like smell or visual sheen in addition to complaints of health issues from ingestion or dermal contact with the Navy and Army system water were received by the Navy and DOH. On November 28, 2021, the Navy reported that a chemical release of petroleum, which is a hazardous substance, entered the JBPHH drinking water distribution system from the Red Hill Shaft source. This release triggered an emergency response and DOH issuance of a public health advisory on November 29, 2021, for the entire JBPHH Public Water System No. HI0000360 (JBPHH System).

The Hawaii DOH, EPA, Navy, and Army formed the Interagency Drinking Water System Team (IDWST) to work on a coordinated effort to restore safe drinking water to all Navy Water System users.

## Has the public health advisory been amended or lifted?

The health advisory for Zone F1 was amended on March 11, 2022 and the advisory for the entire JBPHH System was lifted on March 23, 2023. The amendment to the health advisory was based on the results of extensive flushing, sampling (10% of buildings), and testing activities performed in Zone F1. The IDWST evaluated multiple lines of evidence to determine whether or not drinking water was safe for consumption. DOH determined that the water in Zone F1 was safe and residents/occupants could use their tap water for all purposes including drinking, cooking, oral hygiene, and consumption by pets. LTM of drinking water will be performed to ensure drinking water remains safe for





all residents and occupants of JBPHH. If new information becomes available that indicates contaminants are present in the drinking water that poses a threat to public health, additional investigation may be required.

### **Where does our water come from?**

The source of water for the Navy Water System now comes from the Navy Waiawa Shaft, which was not impacted by the release of Jet Fuel (JP-5) that occurred at Red Hill in late November 2021. The Waiawa Shaft has been sampled, and EPA and the DOH confirmed that it meets all federal and state drinking water standards. The Waiawa Shaft will be sampled (in subsequent sampling rounds) in accordance with the EPA and the DOH requirements.

### **What has the IDWST done to clean the drinking water distribution system?**

The IDWST evaluated multiple options for cleaning the Navy drinking water distribution system and determined that high-volume flushing of the Navy drinking water distribution system (all water mains/laterals/buildings) with 3 to 5 volumes of clean water from the Waiawa Shaft, followed by extensive testing to confirm that flushing worked, would restore safe drinking water to all Navy Water System users.

### **When was Long-Term Monitoring (LTM) water quality sampling conducted in Zone F1?**

Between March 22, 2022 and April 28, 2022, drinking water samples were collected from residences, schools, Child Development Centers, other buildings, and fire hydrants in Zone F1 for LTM Period 1.

Between April 15, 2022 and April 29, 2022, drinking water samples were collected from residences, schools, Child Development Centers, other buildings, and fire hydrants in Zone F1 for LTM Period 2.

Between May 25, 2022 and June 21, 2022, drinking water samples were collected from residences, schools, Child Development Centers, other buildings, and fire hydrants in Zone F1 for LTM Period 3.

Between June 28, 2022 and October 24, 2022, drinking water samples were collected from residences, schools, Child Development Centers, other buildings, and fire hydrants in Zone F1 for LTM Period 4.

Between January 17, 2023 and May 1, 2023, drinking water samples were collected from residences, schools, Child Development Centers, other buildings, and fire hydrants in Zone F1 for LTM Period 5.



Between June 30, 2023 and October 27, 2023, drinking water samples were collected from residences, schools, Child Development Centers, other buildings, and fire hydrants in Zone F1 for LTM Period 6.

### **Where were samples taken?**

Per the IDWST approved sampling plan, ten percent (10%) of all homes and buildings within Zone F1 were sampled. These houses/buildings will be geographically distributed throughout the area to provide spatial coverage along the water supply line. In addition, the list of houses/buildings may be augmented based on additional information (e.g., houses/buildings where occupants reported specific health impacts, houses/buildings that are referred to the team by medical providers) may also be sampled.

### **Where can I get more information about the potential health effects associated with these contaminants?**

Hawaii Department of Health (DOH)

<https://health.hawaii.gov/about/navy-water-system-quality-updates/>.

Call the DOH Safe Drinking Water Branch at 808-586-4258

US Environmental Protection Agency (EPA)

<https://www.epa.gov/ground-water-and-drinking-water/forms/online-form-epas-office-ground-water-and-drinking-water>.

Call EPA Region 9's Environmental Information Center at 1-866-372-9378



## **Explanation of Terms and Acronyms used in this Report**

**Action Level (AL).** This AL is for Lead and Copper. The AL is a measure of the effectiveness of the corrosion control treatment in water systems. The AL is not a standard for establishing a safe level of lead or copper. The AL is the point at which certain provisions of the proposed standards must be initiated.

**Contaminant.** Contaminant is any physical, chemical, biological, or radiological substance or matter in water, and can be either healthy or unhealthy, depending on the particular substance and concentration. It could also be a physical parameter monitored such as pH or temperature.

**DOH.** Hawaii Department of Health

**EPA.** U.S. Environmental Protection Agency

**Incident Specific Parameter (ISP).** To more comprehensively monitor and respond to this specific petroleum contamination of drinking water, the DOH identified contaminants that require additional action prior to amending the Health Advisory. The ISPs are used as a line of evidence to evaluate the data generated in each zone during the investigation conducted by the IDWST.

**Maximum Contaminant Level (MCL).** An MCL is the maximum permissible level of a contaminant in water which is delivered to any user of a public water system. The MCL is set to protect the public from acute and chronic health risks associated with consuming water containing these contaminants.

**Metals.** Metals are not derived from living sources and in general do not contain carbon. Metals include antimony, arsenic, asbestos, barium, beryllium, cadmium, chromium, copper, cyanide, fluoride, lead, mercury, nitrate, nitrite, selenium, and thallium. These contaminants get into drinking water supplies through industrial discharge or spills, erosion of natural deposits, corrosion, sewage discharge, fertilizer runoff, and other sources.

**ND.** Non-Detect

**Project Specific Screening Level.** DOH uses multiple criteria to assess the safety of the drinking water including maximum contaminant levels (MCLs) previously established environmental action levels (EALs) and incident specific parameters (ISPs).

**Synthetic Organic Compounds (SOCs)/Semi-Volatile Organic Compounds (SVOCs).** SOC and SVOC may be used interchangeably and are man-made, organic



(carbon-based) chemicals that are less volatile than Volatile Organic Contaminants (VOCs). They are used as pesticides, defoliants, fuel additives, and as ingredients for other organic chemicals.

**DOH Environmental Action Level (EAL).** The DOH Environmental Action Levels (EALs) are concentrations of contaminants in drinking water and other media (e.g., soil, soil gas, and groundwater) below which the contaminants are assumed to not pose a significant threat to human health or the environment. Exceeding these EAL does not necessarily indicate that contamination at the site poses environmental hazards but generally warrants additional investigation.

**Total Petroleum Hydrocarbons (TPH).** TPH is a term used to describe a large family of several hundred chemical compounds that come from crude oil. Crude oil is used to make petroleum products, which can contaminate the environment. TPH is comprised of detected results from TPH-Gasoline, TPH-Diesel, and TPH-Oil.

**Total Organic Carbon (TOC).** TOC is naturally present in the environment, but also can be an indicator of contamination, including petroleum or other sources.

**Free Chlorine.** Chlorine is added to drinking water as part of the treatment process. Adding chlorine is the most common way to disinfect drinking water. Disinfection kills bacteria, viruses, and other microorganisms that could cause disease or illness. Chlorine is effective and continues to keep the water safe as it travels from the treatment plant to the consumer's tap. Chlorine measurements provide another line-of-evidence for evaluating drinking water quality.

**Total Trihalomethanes (TTHM).** TTHM is the sum of the concentration in milligrams per liter of the trihalomethane compounds (trichloromethane [chloroform], dibromochloromethane, bromodichloromethane and tribromomethane [bromoform]).

**Units.** A unit is the concentration of contaminant found in the water. For this report, the units are expressed in U.S. Standard Units.

U.S. Standard Unit (Name)	Acronym	Equivalent International System of Units (Name)	Acronym
parts per billion	ppb	micrograms per Liter	µg/L

**Volatile Organic Compounds (VOCs).** VOCs are a class of chemicals that contain carbon and evaporate, or volatilize, easily into air at room temperature. VOCs are found in a variety of commercial, industrial, and residential products, including gasoline, solvents, cleaners and degreasers, paints, inks and dyes, and pesticides.